



## Listing and Technical Evaluation Report™

Report No: 1907-04



Issue Date: April 21, 2021

Revision Date: October 1, 2024

Subject to Renewal: October 1, 2025

### Big Timber® Multi-Ply Applications

Trade Secret Report Holder:

Western Builders Supply dba Big Timber®

Phone: 406-252-6309

Website: [www.bigtimberfasteners.com](http://www.bigtimberfasteners.com)

Email: [sales@bigtimberfasteners.com](mailto:sales@bigtimberfasteners.com)

### CSI Designations:

DIVISION: 06 00 00 - WOOD, PLASTICS AND COMPOSITES

Section: 06 05 23 - Wood, Plastic, and Composite Fastenings

## 1 Innovative Products Evaluated<sup>1</sup>

### 1.1 Big Timber Screws:

- 1.1.1 BL Log, Timber and Landscape Screws
- 1.1.2 BTX and YTX General Purpose Screws
- 1.1.3 CTX Construction Lag Screws
- 1.1.4 GL Gray Structural Screws
- 1.1.5 STX and SCTX Stainless Screws
- 1.1.6 WTX Wafer Head Wood Screws

## 2 Product Description and Materials

### 2.1 Fastener Descriptions

- 2.1.1 CTX Construction Lag Screws have a round washer head with a star drive and are partially threaded. The CTX Construction Lag Screw is shown in **Figure 1**.



**Figure 1.** CTX Construction Lag Screw

- 2.1.2 BL Log, Timber and Landscaping Screws and GL Gray Structural Screws have a hex washer head and are partially threaded. The BL and GL screws are shown in **Figure 2** and **Figure 3**, respectively.



**Figure 2.** BL Log, Timber and Landscaping Screw



**Figure 3.** GL Gray Structural Screw

- 2.1.3 BTX and YTX General Purpose Screws have a round flat head with a star drive (Torx screw), and are partially threaded. The BTX screw has a 1200hr Bronze coating for exterior use and the YTX screw has a gold zinc coating for interior use. The BTX and YTX General Purpose Screws are shown in **Figure 4** and **Figure 5**, respectively.



**Figure 4.** BTX General Purpose Screw (Exterior Use)



**Figure 5.** YTX General Purpose Screw (Interior Use)

- 2.1.1 STX and SCTX Stainless Screws are made from Grade 316 stainless steel. The STX screw has a round flat head with ribs and a star drive (Torx screw) and is partially threaded (see **Figure 6**). The SCTX screw has a round washer head and a star drive (Torx screw) and is partially threaded (see **Figure 7**).



**Figure 6.** STX General Purpose Stainless Steel Screw



**Figure 7.** SCTX Construction Lag Stainless Steel Screw

- 2.1.2 WTX Wafer Head Wood Screws have a round wafer head with a star drive (Torx screw) and are partially threaded (see **Figure 8**).



**Figure 8.** WTX Wafer Head Screw

- 2.1.3 All of the screws evaluated in this report are manufactured using a standard cold-formed process followed by a heat-treating process, with the exception of the STX and SCTX, which do not undergo a heat-treating process.

## 2.2 Fastener Coatings

- 2.2.1 CTX Construction Lag Screws are coated with a proprietary coating designated as Bronze Star, which exceeds the protections provided by hot-dipped galvanized coatings conforming to ASTM A153.
- 2.2.2 BL Log, Timber and Landscape Screws and WTX Wafer Head Wood Screws are coated with a proprietary coating designated as Black, which exceeds the protections provided by hot-dipped galvanized coatings conforming to ASTM A153.
- 2.2.3 GL Gray Structural Screws are coated with a proprietary coating designated as Gray, which exceeds the protections provided by hot-dipped galvanized coatings conforming to ASTM A153.
- 2.2.4 BTX General Purpose Screws are coated with a proprietary coating designated as Bronze, which exceeds the protections provided by hot-dipped galvanized coatings conforming to ASTM A153.
- 2.2.5 YTX General Purpose Screws are coated with a proprietary zinc coating designated as Gold Star.



2.3 Big Timber Screws are approved for use in chemically treated or untreated lumber where ASTM A153, Class D coatings are approved for use in accordance with IBC Section 2304.10 and IRC Section R317.3.

2.3.1 The proprietary coating and stainless material have been tested and found to exceed the protection provided by code-approved hot-dipped galvanized coatings meeting ASTM A153, Class D (IBC Section 2304.10.6<sup>2</sup> and IRC Section R317.3, allowing for its use in pressure-treated wood.

2.3.2 Fasteners are approved for use in fire-retardant treated lumber, provided the conditions set forth by the fire-retardant treated lumber manufacturer be met, including appropriate strength reductions.

2.4 The STX and SCTX Stainless Screws are approved for use in chemically treated wood with exposure to saltwater, including coastal construction applications.

2.5 The CTX Construction Lag Screws evaluated in this report are set forth in **Table 1**.

**Table 1. CTX Fastener Specifications**

Fastener	Designation	Head		Nominal Length <sup>1</sup> (in)	Thread Length <sup>1</sup> (in)	Shank Diameter <sup>2</sup> (in)	Thread Diameter (in)		Specified Minimum Core Hardness <sup>4</sup> (HV 0.3)	Nominal Bending Yield, $f_{yb}$ (psi)	Allowable Fastener Strength (lbf)	
		Diameter (in)	Drive Type				Minor	Major			Tensile	Shear <sup>3</sup>
CTX	14 x 3	0.531	Torx 25	3	2	0.168	0.146	0.242	355	141,300	930	725
	14 x 4			4	2							
	14 x 5			5	3							
	14 x 6			6	3							
	15 x 3	0.620	Torx 30	3	2	0.202	0.179	0.275	355	151,600	1,475	1,020
	15 x 3 1/2			3 1/2	2 1/2							
	15 x 4			4	2 1/2							
	15 x 5			5	3							
	15 x 6			6	3							
	17 x 4	0.675	Torx 40	4	2 1/2	0.226	0.210	0.295	355	170,500	1,850	1,240
	17 x 5			5	3							
	17 x 6			6	3							
	17 x 7			7	3 1/2							

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the underside of the head to the tip. Thread length includes tapered tip.
2. Shank diameter based on manufactured thickness. Finished dimensions are larger, due to the proprietary coatings added.
3. Shear determined at smooth shank diameter.
4. Based on a 300-gram load using the Vickers indenter.



2.6 The BL Log, Timber and Landscaping Screws and GL Gray Structural Screws evaluated in this report are set forth in **Table 2**.

**Table 2.** BL and GL Fastener Specifications

Fastener	Designation	Head		Nominal Length <sup>1</sup> (in)	Thread Length <sup>1</sup> (in)	Shank Diameter <sup>2</sup> (in)	Thread Diameter (in)		Specified Minimum Core Hardness <sup>4</sup> (HV 0.3)	Nominal Bending Yield, f <sub>y</sub> b (psi)	Allowable Fastener Strength (lbf)	
		Diameter (in)	Drive Type				Minor	Major			Tensile	Shear <sup>3</sup>
BL	14 x 4	0.487	Hex <sup>5</sup> / <sub>16</sub>	4	2	0.189	0.171	0.258	355	177,700	1,085	725
	14 x 5			5	2							
	14 x 6			6	2							
	14 x 7			7	2½							
BL GL	17 x 4	0.570	Hex <sup>5</sup> / <sub>16</sub>	4	2	0.224	0.211	0.297	355	172,600	1,990	1,240
	17 x 5			5	3							
	17 x 6			6	3							
	17 x 7			7	3							

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

- Fastener length is measured from the underside of the head to the tip. Thread length includes tapered tip.
- Shank diameter based on manufactured thickness. Finished dimensions are larger, due to the proprietary coatings added.
- Shear determined at smooth shank diameter.
- Based on a 300-gram load using the Vickers indenter.



2.7 The BTX and YTX General Purpose Screws evaluated in this report are set forth in **Table 3**.

**Table 3.** BTX and YTX Fastener Specifications

Fastener	Designation	Head		Nominal Length <sup>1</sup> (in)	Thread Length <sup>1</sup> (in)	Shank Diameter <sup>2</sup> (in)	Thread Diameter (in)		Specified Minimum Core Hardness <sup>4</sup> (HV 0.3)	Nominal Bending Yield, $f_{yb}$ (psi)	Allowable Fastener Strength (lbf)	
		Diameter (in)	Drive Type				Minor	Major			Tensile	Shear <sup>3</sup>
BTX YTX	9 x 3	0.344	T25	3	1½	0.135	0.122	0.175	355	211,000	820	595
	10 x 3	0.374	T25	3	1½	0.151	0.134	0.209	355	205,000	960	710
	10 x 3½			3½	2							
	10 x 4			4	2							
	10 x 5			5	2½							
	10 x 6			6	2½							
BTX	14 x 5	0.465	T30	5	2½	0.169	0.145	0.232	286	211,000	1,270	960
	14 x 6			6	2½							
	14 x 7			7	2½							
	10 x 6			6	2½							

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the top of the head to the tip. Thread length includes the tapered tip and excludes the knurl.
2. Shank diameter based on manufactured thickness. Finished dimensions are larger, due to the proprietary coatings added.
3. Shear strength applicable at both the smooth shank and thread diameter.
4. Based on a 300-gram load using the Vickers indenter.



2.8 The STX and SCTX Stainless Screws evaluated in this report are set forth in **Table 4**.

**Table 4.** STX and SCTX Fastener Specifications

Fastener	Designation	Head		Nominal Length <sup>1</sup> (in)	Thread Length <sup>1</sup> (in)	Shank Diameter <sup>2</sup> (in)	Thread Diameter (in)		Nominal Bending Yield, f <sub>y</sub> <sup>b</sup> (psi)	Allowable Fastener Strength (lbf)	
		Diameter (in)	Drive Type				Minor	Major		Tensile	Shear <sup>3</sup>
STX	9 x 3	0.350	T25	3	1½	0.130	0.110	0.181	122,000	375	340
	10 x 3	0.376	T25	3	1½	0.145	0.126	0.193	124,000	440	420
	10 x 3½			3½	2						
	10 x 4			4	2						
SCTX	15 x 3	0.620	Torx 30	3	2	0.202	0.179	0.275	111,000	855	725
	15 x 3½			3½	2½						
	15 x 4			4	2½						
	15 x 5			5	3						
	15 x 6			6	3						
	15 x 7			7	3½						

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

- Fastener length is measured from the top of the head to the tip. Thread length includes the tapered tip.
- Shank diameter based on manufactured thickness.
- Shear strength applicable at both the smooth shank and thread diameter.

2.9 The WTX Wafer Head Wood Screws evaluated in this report are set forth in **Table 5**.

**Table 5.** WTX Fastener Specifications

Fastener	Designation	Head		Nominal Length <sup>1</sup> (in)	Thread Length <sup>1</sup> (in)	Shank Diameter <sup>2</sup> (in)	Thread Diameter (in)		Specified Minimum Core Hardness <sup>4</sup> (HV 0.30)	Nominal Bending Yield, f <sub>yb</sub> (psi)	Allowable Fastener Strength (lbf)	
		Diameter (in)	Drive Type				Minor	Major			Tensile	Shear <sup>3</sup>
WTX	15 x 3"	0.659	Torx 30	3	2 <sup>3</sup> / <sub>4</sub>	0.205	0.187	0.274	286	190,000	1,545	1,165
	15 x 3 <sup>1</sup> / <sub>2</sub> "			3 <sup>1</sup> / <sub>2</sub>	2							
	15 x 4"			4	2							
	15 x 5"			5	2							
	15 x 6"			6	2 <sup>1</sup> / <sub>2</sub>							

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

- Fastener length is measured from the top of the head to the tip. Thread length includes the tapered tip.
- Shank diameter based on manufactured thickness.
- Shear strength applicable at both the smooth shank and thread diameter.
- Based on a 300-gram load using the Vickers indenter.

2.10 As needed, review material properties for design in **Section 6** and to regulatory evaluation in **Section 8**.

### 3 Definitions

- 3.1 New Materials<sup>3</sup> are defined as building materials, equipment, appliances, systems, or methods of construction not provided for by prescriptive and/or legislatively adopted regulations, known as alternative materials.<sup>4</sup> The design strengths and permissible stresses shall be established by tests<sup>5</sup> and/or engineering analysis.<sup>6</sup>
- 3.2 Duly authenticated reports<sup>7</sup> and research reports<sup>8</sup> are test reports and related engineering evaluations, which are written by an approved agency<sup>9</sup> and/or an approved source.<sup>10</sup>
- 3.2.1 These reports contain intellectual property and/or trade secrets, which are protected by the Defend Trade Secrets Act (DTSA).<sup>11</sup>
- 3.3 An approved agency is "approved" when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is listed in the ANAB directory.
- 3.4 An approved source is "approved" when a professional engineer (i.e., Registered Design Professional) is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.<sup>12</sup>
- 3.5 Testing and/or inspections conducted for this duly authenticated report were performed by an ISO/IEC 17025 accredited testing laboratory, an ISO/IEC 17020 accredited inspection body, and/or a licensed Registered Design Professional (RDP).
- 3.5.1 The Center for Building Innovation (CBI) is ANAB<sup>13</sup> ISO/IEC 17025 and ISO/IEC 17020 accredited.
- 3.6 The regulatory authority shall enforce<sup>14</sup> the specific provisions of each legislatively adopted regulation. If there is a non-conformance, the specific regulatory section and language of the non-conformance shall be provided in writing<sup>15</sup> stating the nonconformance and the path to its cure.



- 3.7 The regulatory authority shall accept duly authenticated reports from an approved agency and/or an approved source with respect to the quality and manner of use of new materials or assemblies as provided for in regulations regarding the use of alternative materials, designs, or methods of construction.<sup>16</sup>
- 3.8 ANAB is an International Accreditation Forum (IAF) Multilateral Recognition Arrangement (MLA) signatory where recognition of certificates, validation, and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA with the appropriate scope, shall be approved.<sup>17</sup> Therefore, all ANAB ISO/IEC 17065 duly authenticated reports are approval equivalent.<sup>18</sup>
- 3.9 Approval equity is a fundamental commercial and legal principle.<sup>19</sup>

#### 4 Applicable Standards for the Listing; Regulations for the Regulatory Evaluation<sup>20</sup>

##### 4.1 Standards

- 4.1.1 *AISI S904: Standard Test Methods for Determining the Tensile and Shear Strength of Screws*
- 4.1.2 *ANSI/AWC NDS: National Design Specification (NDS) for Wood Construction*
- 4.1.3 *ASTM A153: Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware*
- 4.1.4 *ASTM A510: Standard Specification for General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel, and Alloy Steel*
- 4.1.5 *ASTM A580: Standard Specification for Stainless Steel Wire*
- 4.1.6 *ASTM B117: Standard Test Methods for Operating Salt Spray (Fog) Apparatus*
- 4.1.7 *ASTM D1761: Standard Test Methods for Mechanical Fasteners in Wood and Wood-Based Materials*
- 4.1.8 *ASTM D2395: Standard Test Methods for Density and Specific Gravity (Relative Density) of Wood and Wood-Based Materials*
- 4.1.9 *ASTM D2915: Standard Practice for Sampling and Data-Analysis for Structural Wood and Wood-Based Products*
- 4.1.10 *ASTM D4442: Standard Test Methods for Direct Moisture Content Measurement of Wood and Wood-Based Materials*
- 4.1.11 *ASTM F1575: Standard Test Method for Determining Bending Yield Moment of Nails*
- 4.1.12 *ASTM G85: Standard Practice for Modified Salt Spray (Fog) Testing*

##### 4.2 Regulations

- 4.2.1 *IBC – 15, 18, 21: International Building Code®*
- 4.2.2 *IRC – 15, 18, 21: International Residential Code®*

#### 5 Listed<sup>21</sup>

- 5.1 Equipment, materials, products, or services included in a List published by a nationally recognized testing laboratory (i.e., CBI), approved agency (i.e., CBI and DrJ), and/or approved source (i.e., DrJ) or other organization concerned with product evaluation (i.e., DrJ) that maintains periodic inspection (i.e., CBI) of production of listed equipment or materials, and whose listing states either that the equipment or material meets nationally recognized standards or has been tested and found suitable for use in a specified manner.

## 6 Tabulated Properties Generated from Nationally Recognized Standards

### 6.1 General


- 6.1.1 Big Timber Screws are used for attaching multi-ply wood members including trusses, sawn lumber and SCL products.
- 6.1.2 Where the application exceeds the limitations set forth herein, design shall be permitted in accordance with accepted engineering procedures, experience, and technical judgment.

### 6.2 Design

- 6.2.1 Design of Big Timber Screws is governed by the applicable code and the provisions for dowel type fasteners in NDS.
- 6.2.2 Unless otherwise noted, adjustment of the design stresses for duration of load shall be in accordance with the applicable code.


### 6.3 Multi-Ply Connection Design Values

- 6.3.1 Sawn lumber design values are provided for assemblies with two, three or four plies. Sawn lumber assemblies are detailed in **Figure 9**.

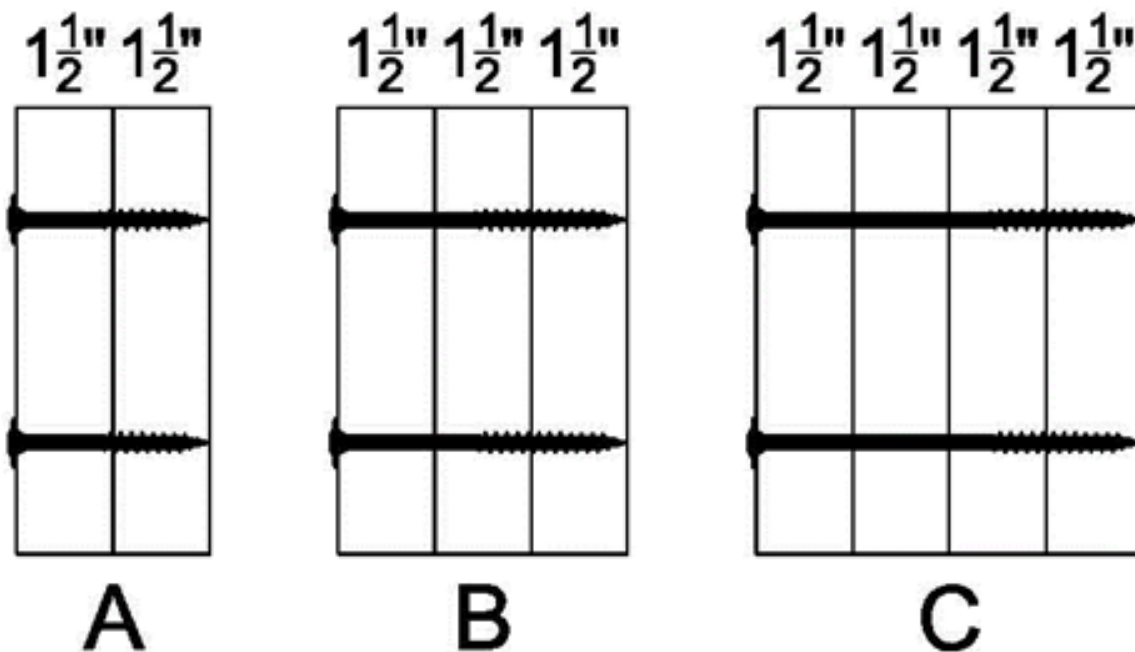

**Figure 9.** Big Timber Screw Sawn Lumber Assemblies

6.3.2 SCL design values are provided for assemblies with two, three or four plies. SCL assemblies are detailed in **Figure 10**.

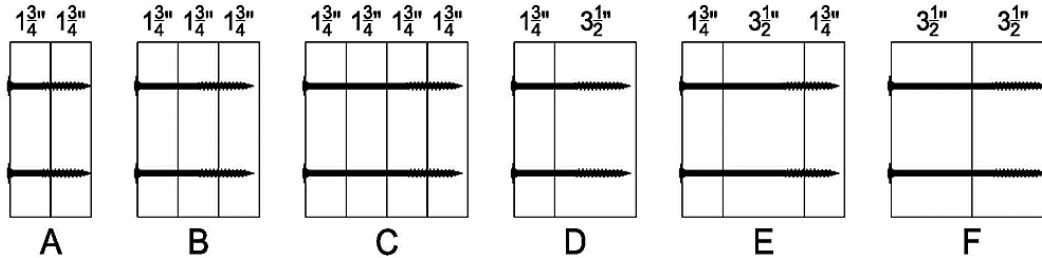

**Figure 10.** Big Timber Screw SCL Assemblies

6.3.3 CTX Construction Lag Screws used in sawn lumber assemblies with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 6**. Assemblies are detailed in **Figure 9**.

**Table 6.** CTX Screw Allowable Lateral Design Values (plf) in Sawn Lumber Assemblies<sup>2,3,4</sup>

Fastener	Assembly	Members	Fastener Length <sup>1</sup> (in)	SPF/HF (SG=0.42)						DF/SP (SG=0.50)					
				12" o.c.		16" o.c.		24" o.c.		12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row											
				2	3	2	3	2	3	2	3	2	3	2	3
CTX14	A	2-ply 1 1/2"	3	485	730	365	550	245	370	575	865	430	645	290	435
	B	3-ply 1 1/2"	4	365	550	275	415	185	280	430	645	325	490	215	325
	C	4-ply 1 1/2"	6	325	490	245	370	165	250	380	570	285	430	190	285
CTX15	A	2-ply 1 1/2"	3	520	780	390	585	260	390	685	1030	515	775	345	520
	B	3-ply 1 1/2"	4	545	820	410	615	275	415	710	1065	535	805	355	535
	C	4-ply 1 1/2"	6	345	520	260	390	175	265	460	690	345	520	230	345
CTX17	B	3-ply 1 1/2"	4	625	940	470	705	315	475	800	1200	600	900	400	600
	C	4-ply 1 1/2"	6	360	540	270	405	180	270	500	750	375	565	250	375

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the underside of the head to the tip.
2. Wood framing shall be any species with specific gravity, SG, of 0.42 or greater.
3. Allowable design values are based on a load duration factor  $C_D = 1.0$  and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, fasteners shall be installed in two (2) rows with a maximum distance of 32" o.c. (on-center) between fasteners in the same row.



6.3.4 CTX Construction Lag Screws used for SCL assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 7**. Assemblies are detailed in **Figure 10**.

**Table 7.** CTX Screw Allowable Lateral Design Values (plf) in SCL Assemblies<sup>2,3,4</sup>

Fastener	Assembly	Members	Fastener Length <sup>1</sup> (in)	12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row					
				2	3	2	3	2	3
CTX14	B	3-ply 1 <sup>3</sup> / <sub>4</sub> "	5	675	1015	510	765	340	510
	D	2-ply 1 <sup>3</sup> / <sub>4</sub> " & 3 <sup>1</sup> / <sub>2</sub> "	5	675	1015	510	765	340	510
CTX15	A	2-ply 1 <sup>3</sup> / <sub>4</sub> "	3 <sup>1</sup> / <sub>2</sub>	685	1030	515	775	345	520
	B	3-ply 1 <sup>3</sup> / <sub>4</sub> "	5	1015	1525	765	1150	510	765
	D	2-ply 1 <sup>3</sup> / <sub>4</sub> " & 3 <sup>1</sup> / <sub>2</sub> "	5	1015	1525	765	1150	510	765
CTX17	B	3-ply 1 <sup>3</sup> / <sub>4</sub> "	5	1125	1690	845	1270	565	850
	C	4-ply 1 <sup>3</sup> / <sub>4</sub> "	7	585	880	440	660	295	445
	D	2-ply 1 <sup>3</sup> / <sub>4</sub> " & 3 <sup>1</sup> / <sub>2</sub> "	5	1125	1690	845	1270	565	850
	E	3-ply 1 <sup>3</sup> / <sub>4</sub> " & 3 <sup>1</sup> / <sub>2</sub> "	7	585	880	440	660	295	445
	F	2-ply 3 <sup>1</sup> / <sub>2</sub> "	7	1120	1680	840	1260	560	840

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the underside of the head to the tip.
2. SCL shall have an SG of 0.50 or greater. Thicknesses listed in **Figure 10** are a minimum.
3. Allowable design values are based on a load duration factor of  $C_D = 1.0$  and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, and a depth of 18" or less, fasteners shall be installed in two (2) rows with a maximum distance of 24" o.c. between fasteners in the same row. Use three (3) rows for members deeper than 18".



6.3.5 BL Log, Timber and Landscaping Screws and GL Gray Structural Screws used in sawn lumber assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 8**. Assemblies are detailed in **Figure 9**.

**Table 8.** BL and GL Screw Allowable Lateral Design Values (plf) in Sawn Lumber Assemblies<sup>2,3,4</sup>

Fastener	Assembly	Members	Fastener Length <sup>1</sup> (in)	SPF/HF (SG=0.42)						DF/SP (SG=0.50)					
				12" o.c.		16" o.c.		24" o.c.		12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row											
				2	3	2	3	2	3	2	3	2	3	2	3
BL14	B	3-ply 1 1/2"	4	385	580	290	435	195	295	525	790	395	595	265	400
	C	4-ply 1 1/2"	6	345	520	260	390	175	265	470	705	355	535	235	355
BL17 GL17	B	3-ply 1 1/2"	4	480	720	360	540	240	360	560	840	420	630	280	420
	C	4-ply 1 1/2"	6	705	1060	530	795	355	535	705	1060	530	795	355	535

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

- Fastener length is measured from the underside of the head to the tip.
- Wood framing shall be any species with SG of 0.42 or greater.
- Allowable design values are based on a load duration factor  $C_D = 1.0$  and shall be multiplied by all applicable adjustment factors per the NDS.
- For top-loaded members with even loading across the width of the entire assembly, fasteners shall be installed in two (2) rows with a maximum distance of 32" o.c. (on-center) between fasteners in the same row.



6.3.6 BL Log, Timber and Landscaping Screws and GL Gray Structural Screws used in SCL assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 9**. Assemblies are detailed in **Figure 10**.

**Table 9.** BL and GL Screw Allowable Lateral Design Values (plf) in SCL Assemblies<sup>2,3,4</sup>

Fastener	Assembly	Members	Fastener Length <sup>1</sup> (in)	12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row					
				2	3	2	3	2	3
BL14	B	3-ply 1 <sup>3</sup> / <sub>4</sub> "	5	525	790	395	595	265	400
	C	4-ply 1 <sup>3</sup> / <sub>4</sub> "	7	680	1020	510	765	340	510
	D	2-ply 1 <sup>3</sup> / <sub>4</sub> " & 3 <sup>1</sup> / <sub>2</sub> "	5	525	790	395	595	265	400
	E	3-ply 1 <sup>3</sup> / <sub>4</sub> " & 3 <sup>1</sup> / <sub>2</sub> "	7	680	1020	510	765	340	510
	F	2-ply 3 <sup>1</sup> / <sub>2</sub> "	7	1020	1530	765	1150	510	765
BL17 GL 17	B	3-ply 1 <sup>3</sup> / <sub>4</sub> "	5	795	1195	600	900	400	600
	C	4-ply 1 <sup>3</sup> / <sub>4</sub> "	7	705	1060	530	795	355	535
	D	2-ply 1 <sup>3</sup> / <sub>4</sub> " & 3 <sup>1</sup> / <sub>2</sub> "	5	795	1195	600	900	400	600
	E	3-ply 1 <sup>3</sup> / <sub>4</sub> " & 3 <sup>1</sup> / <sub>2</sub> "	7	705	1060	530	795	355	535
	F	2-ply 3 <sup>1</sup> / <sub>2</sub> "	7	1060	1590	795	1195	530	795

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

- Fastener length is measured from the underside of the head to the tip.
- SCL shall have an SG of 0.50 or greater. Thicknesses listed in **Figure 10** are a minimum.
- Allowable design values are based on a load duration factor of C<sub>D</sub> = 1.0 and shall be multiplied by all applicable adjustment factors per the NDS.
- For top-loaded members with even loading across the width of the entire assembly, and a depth of 18" or less, fasteners shall be installed in two (2) rows with a maximum distance of 24" o.c. between fasteners in the same row. Use three (3) rows for members deeper than 18".



6.3.7 BTX and YTX General Purpose Screws used in sawn lumber assemblies with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 10**. Assemblies are detailed in **Figure 9**.

**Table 10.** BTX and YTX Screw Allowable Lateral Design Values (plf) in Sawn Lumber Assemblies<sup>2,3,4</sup>

Fastener	Assembly	Members	Fastener Length <sup>1</sup> (in)	SPF/HF (SG=0.42)						DF/SP (SG=0.50)					
				12" o.c.		16" o.c.		24" o.c.		12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row											
				2	3	2	3	2	3	2	3	2	3	2	3
BTX9 YTX9	A	2-ply 1½"	3	640	960	480	720	320	480	840	1260	630	945	420	630
BTX10 YTX10	A	2-ply 1½"	3	660	990	495	745	330	495	660	990	495	745	330	495
	B	3-ply 1½"	4	495	745	370	555	250	375	495	745	370	555	250	375
	C	4-ply 1½"	6	440	660	330	495	220	330	440	660	330	495	220	330
BTX14	C	4-ply 1½"	6	750	1125	565	850	375	565	920	1380	690	1035	460	690

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

- Fastener length is measured from the top of the head to the tip.
- Wood framing shall be any species with specific gravity, SG, of 0.42 or greater.
- Allowable design values are based on a load duration factor  $C_D = 1.0$  and shall be multiplied by all applicable adjustment factors per the NDS.
- For top-loaded members with even loading across the width of the entire assembly, fasteners shall be installed in two (2) rows with a maximum distance of 32" o.c. (on-center) between fasteners in the same row.



6.3.8 BTX and YTX General Purpose Screws used in SCL assemblies with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 11**. Assemblies are detailed in **Figure 10**.

**Table 11.** BTX Screw Allowable Lateral Design Values (plf) in SCL Assemblies<sup>2,3,4</sup>

Fastener	Assembly	Members	Fastener Length <sup>1</sup> (in)	12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row					
				2	3	2	3	2	3
BTX10 YTX10	A	2-ply 1¾"	3½	580	870	435	655	290	435
	B	3-ply 1¾"	5	465	700	350	525	235	355
	D	2-ply 1¾" & 3½"	5	465	700	350	525	235	355
BTX14	B	3-ply 1¾"	5	1035	1555	780	1170	520	780
	C	4-ply 1¾"	7	920	1380	690	1035	460	690
	D	2-ply 1¾" & 3½"	5	1035	1555	780	1170	520	780
	E	3-ply 1¾" & 3½"	7	920	1380	690	1035	460	690
	F	2-ply 3½"	7	1580	2370	1190	1785	790	1185

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the top of the head to the tip.
2. SCL shall have a specific gravity, SG, of 0.50 or greater. Thicknesses listed in **Figure 9** are a minimum.
3. Allowable design values are based on a load duration factor of  $C_D = 1.0$  and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, and a depth of 18" or less, fasteners shall be installed in two (2) rows with a maximum distance of 24" o.c. between fasteners in the same row. Use three (3) rows for members deeper than 18".



6.3.9 STX and SCTX Stainless Screws used in sawn lumber assemblies with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 12**. Assemblies are detailed in **Figure 9**.

**Table 12.** STX and SCTX Screw Allowable Lateral Design Values (plf) in Sawn Lumber Assemblies<sup>2,3,4</sup>

Fastener	Assembly	Members	Fastener Length <sup>1</sup> (in)	SPF/HF (SG=0.42)						DF/SP (SG=0.50)					
				12" o.c.		16" o.c.		24" o.c.		12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row											
				2	3	2	3	2	3	2	3	2	3	2	3
STX9	A	2-ply 1½"	3	260	390	195	295	130	195	305	460	230	345	155	235
STX10	A	2-ply 1½"	3	340	510	255	385	170	255	400	600	300	450	200	300
	B	3-ply 1½"	4	255	385	190	285	130	195	300	450	225	340	150	225
SCTX15	A	2-ply 1½"	3	500	750	375	565	250	375	585	880	440	660	295	445
	B	3-ply 1½"	4	375	565	280	420	190	285	440	660	330	495	220	330
	C	4-ply 1½"	6	335	505	250	375	170	255	390	585	295	445	195	295

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

- Fastener length is measured from the top of the head to the tip.
- Wood framing shall be any species with specific gravity, SG, of 0.42 or greater.
- Allowable design values are based on a load duration factor CD = 1.0 and shall be multiplied by all applicable adjustment factors per the NDS.
- For top-loaded members with even loading across the width of the entire assembly, fasteners shall be installed in two (2) rows with a maximum distance of 32" o.c. between fasteners in the same row.



6.3.10 STX and SCTX Stainless Screws used in SCL assemblies with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 13**. Assemblies are detailed in **Figure 10**.

**Table 13.** STX and SCTX Screw Allowable Lateral Design Values (plf) in SCL Assemblies<sup>2,3,4</sup>

Fastener	Assembly	Members	Fastener Length <sup>1</sup> (in)	12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row					
				2	3	2	3	2	3
STX10	A	2-ply 1¾"	3½	400	600	300	450	200	300
SCTX15	A	2-ply 1¾"	3½	585	880	440	660	295	445
	B	3-ply 1¾"	5	440	660	330	495	220	330
	C	4-ply 1¾"	7	390	585	295	445	195	295
	D	2-ply 1¾" & 3½"	5	440	660	330	495	220	330
	E	3-ply 1¾" & 3½"	7	390	585	295	445	195	295
	F	2-ply 3½"	7	585	880	440	660	295	445

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the top of the head to the tip.
2. SCL shall have a specific gravity, SG, of 0.50 or greater. Thicknesses listed in **Figure 10** are a minimum.
3. Allowable design values are based on a load duration factor of  $C_D = 1.0$  and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, and a depth of 18" or less, fasteners shall be installed in two (2) rows with a maximum distance of 24" o.c. between fasteners in the same row. Use three (3) rows for members deeper than 18".

6.3.11 WTX Wafer Head Wood Screws used in sawn lumber assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 14**. Assemblies are detailed in **Figure 9**.

**Table 14.** WTX Screw Allowable Lateral Design Values (plf) in Sawn Lumber Assemblies<sup>2,3,4</sup>

Fastener	Assembly	Members	Fastener Length <sup>1</sup> (in)	SPF/HF (SG=0.42)						DF/SP (SG=0.50)					
				12" o.c.		16" o.c.		24" o.c.		12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row											
				2	3	2	3	2	3	2	3	2	3	2	3
WTX15	A	2-ply 1 1/2"	3	800	1200	600	900	400	600	1000	1500	750	1125	500	750
	B	3-ply 1 1/2"	4	590	885	445	670	295	445	750	1125	565	850	375	565
	C	4-ply 1 1/2"	6	535	805	400	600	270	405	665	1000	500	750	335	505

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the top of the head to the tip.
2. Wood framing shall be any species with SG of 0.42 or greater.
3. Allowable design values are based on a load duration factor  $C_D = 1.0$  and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, fasteners shall be installed in two (2) rows with a maximum distance of 32" o.c. (on-center) between fasteners in the same row.



6.3.12 WTX Wafer Head Wood Screws used in SCL assemblies with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 15**. Assemblies are detailed in **Figure 10**.

**Table 15.** WTX Screw Allowable Lateral Design Values (plf) in SCL Assemblies<sup>2,3,4</sup>

Fastener	Assembly	Members	Fastener Length <sup>1</sup> (in)	12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row					
				2	3	2	3	2	3
WTX15	A	2-ply 1 <sup>3</sup> / <sub>4</sub> "	3 <sup>1</sup> / <sub>2</sub>	1000	1500	750	1125	500	750
	B	3-ply 1 <sup>3</sup> / <sub>4</sub> "	5	750	1125	565	850	375	565
	D	2-ply 1 <sup>3</sup> / <sub>4</sub> " & 3 <sup>1</sup> / <sub>2</sub> "	5	750	1125	565	850	375	565

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

- Fastener length is measured from the top of the head to the tip.
- SCL shall have an SG of 0.50 or greater. Thicknesses listed in **Figure 9** are a minimum.
- Allowable design values are based on a load duration factor of C<sub>D</sub> = 1.0 and shall be multiplied by all applicable adjustment factors per the NDS.
- For top-loaded members with even loading across the width of the entire assembly, and a depth of 18" or less, fasteners shall be installed in two (2) rows with a maximum distance of 24" o.c. between fasteners in the same row. Use three (3) rows for members deeper than 18".

6.4 Where the application falls outside of the performance evaluation, conditions of use, and/or installation requirements set forth herein, alternative techniques shall be permitted in accordance with accepted engineering practice and experience. This includes but is not limited to the following areas of engineering: mechanics or materials, structural, building science, and fire science.

## 7 Certified Performance<sup>22</sup>

- All construction methods shall conform to accepted engineering practices to ensure durable, livable, and safe construction and shall demonstrate acceptable workmanship reflecting journeyman quality of work of the various trades.<sup>23</sup>
- The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.<sup>24</sup>

## 8 Regulatory Evaluation and Accepted Engineering Practice

- Big Timber Screws comply with the following legislatively adopted regulations and/or accepted engineering practice for the following reasons:
  - Big Timber Screws were evaluated for their ability to provide multi-ply attachment in trusses, sawn lumber and Structural Composite Lumber (SCL) applications.
  - Unless otherwise noted, use of Big Timber Screws in locations exposed to saltwater or saltwater spray is outside the scope of this report.
- Any building code, regulation, and/or accepted engineering evaluations (i.e., research reports, duly authenticated reports, etc.) that are conducted for this Listing were performed by DrJ Engineering, LLC (DrJ), an ISO/IEC 17065 accredited certification body and a professional engineering company operated by RDP/approved sources. DrJ is qualified<sup>25</sup> to practice product and regulatory compliance services within its scope of accreditation and engineering expertise, respectively.



8.3 Engineering evaluations are conducted with DrJ's ANAB accredited ICS code scope of expertise, which are also its areas of professional engineering competence.

8.4 Any regulation specific issues not addressed in this section are outside the scope of this report.

## 9 Installation

9.1 Installation shall comply with the approved construction documents, the manufacturer installation instructions, this report, and the applicable building code.

9.2 In the event of a conflict between the manufacturer installation instructions and this report, the more restrictive shall govern.

### 9.3 Installation Procedure

- 9.3.1 Big Timber Screws shall be installed using a high-torque low speed drill in accordance with the manufacturer installation instructions, applicable code, the approved construction documents, this report, NDS and standard framing practice as applied to wood fasteners.
- 9.3.2 Each Big Timber Screw shall be installed using the appropriate driver bit and never struck with a hammer. Do not overdrive.
- 9.3.3 Install Big Timber Screws so that as many threads fully engage the main member (final member in multi-ply assembly) as possible when head is fully seated against the lumber.
- 9.3.4 Lead holes are not required.
- 9.3.5 For applications outside the scope of this report, an engineered design is required.
- 9.3.6 Minimum requirement for fastener spacing, edge distance, and end distance shall be in accordance with **Table 16**.

**Table 16.** Minimum Spacing, Edge Distance and End Distance Requirements

Connection Geometry	Minimum Spacing/Distance (in)								
	STX9	BTX9 YTX9	STX10	BTX10, YTX10	CTX14, BTX14	BL14	CTX15, SCTX15, WTX15	BL17, GL17	CTX17
Edge Distance – Load in any direction	3⁄8			1⁄2		1¹⁄₂	5⁄8	1⁷⁄₈	
End Distance – Load parallel to grain, towards end	2	2¼		2³⁄₈	2⁵⁄₈	2⁷⁄₈	3¹⁄₈	3³⁄₈	3³⁄₈
End Distance – Load parallel to grain, away from end	1³⁄₈		1¹⁄₂	1⁵⁄₈	1¾	1⁷⁄₈	2¹⁄₈	2¼	2¼
End Distance – Load perpendicular to grain	1³⁄₈		1¹⁄₂	1⁵⁄₈	1¾	1⁷⁄₈	2¹⁄₈	2¼	2¼
Spacing between Fasteners in a Row – Parallel to grain	2	2¼		2³⁄₈	2⁵⁄₈	2⁷⁄₈	3¹⁄₈	3³⁄₈	3³⁄₈
Spacing between Fasteners in a Row – Perpendicular to grain	1³⁄₈		1¹⁄₂	1⁵⁄₈	1¾	1⁷⁄₈	2¹⁄₈	2¼	2¼
Spacing between Rows of Fasteners – In-line	¾			⁷⁄₈		1	1¹⁄₈		1¹⁄₈
Spacing between Rows of Fasteners – Staggered	3⁄8			1⁄2			5⁄8		
SI: 1 in = 25.4 mm									
1. Edge distances, end distances and spacing of fasteners shall be sufficient to prevent splitting of the wood or as shown in this table, whichever is more restrictive.									



## 10 Substantiating Data

- 10.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:
- 10.1.1 Connection design value calculations by DrJ Engineering, LLC in accordance with NDS and accepted engineering practice.
- 10.2 Properties for Big Timber CTX Construction Lag Screws are from Report Number 1907-01.
- 10.3 Properties for Big Timber BL Log, Timber & Landscape Screws, and GL Gray Structural Screws are from Report Number 1907-02.
- 10.4 Properties for Big Timber BTX and YTX General Purpose Screws are from Report Number 1911-01.
- 10.5 Properties for Big Timber STX and SCTX Stainless Screws are from Report Number 1911-02.
- 10.6 Properties for Big Timber WTX Wafer Head Screws are from Report Number 1911-04.
- 10.7 Information contained herein may include the result of testing and/or data analysis by sources that are approved agencies, approved sources, and/or RDPs. Accuracy of external test data and resulting analysis is relied upon.
- 10.8 Where applicable, testing and/or engineering analysis are based upon provisions that have been codified into law through state or local adoption of regulations and standards. The developers of these regulations and standards are responsible for the reliability of published content. DrJ's engineering practice may use a regulation-adopted provision as the control. A regulation-endorsed control versus a simulation of the conditions of application to occur establishes a new material as being equivalent to the regulatory provision in terms of quality, strength, effectiveness, fire resistance, durability, and safety.
- 10.9 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, or duly authenticated reports from approved agencies and/or approved sources provided by the supplier. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this duly authenticated report, may be dependent upon published design properties by others.
- 10.10 Testing and engineering analysis: The strength, rigidity, and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.<sup>26</sup>
- 10.11 Where additional condition of use and/or regulatory compliance information is required, please search for Big Timber Screws on the DrJ Certification website.

## 11 Findings

- 11.1 As outlined in **Section 6**, Big Timber Screws have performance characteristics that were tested and/or meet applicable regulations and are suitable for use pursuant to its specified purpose.
- 11.2 When used and installed in accordance with this duly authenticated report and the manufacturer installation instructions, Big Timber Screws shall be approved for the following applications:
- 11.2.1 To provide multi-ply attachment in trusses, sawn lumber, and SCL assemblies.
- 11.3 Unless exempt by state statute, when Big Timber Screws are to be used as a structural and/or building envelope component in the design of a specific building, the design shall be performed by an RDP.
- 11.4 Any application specific issues not addressed herein can be engineered by an RDP. Assistance with engineering is available from Big Timber.



11.5 IBC Section 104.11 (IRC Section R104.11 and IFC Section 104.10<sup>27</sup> are similar) in pertinent part states:

**104.11 Alternative materials, design and methods of construction and equipment.** The provisions of this code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by this code. Where the alternative material, design or method of construction is not approved, the building official shall respond in writing, stating the reasons the alternative was not approved.

11.6 **Approved:**<sup>28</sup> Building regulations require that the building official shall accept duly authenticated reports.<sup>29</sup>

11.6.1 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited.

11.6.2 An approved source is “approved” when an RDP is properly licensed to transact engineering commerce.

11.6.3 Federal law, Title 18 US Code Section 242, requires that where the alternative product, material, service, design, assembly, and/or method of construction is not approved, the building official shall respond in writing, stating the reasons why the alternative was not approved. Denial without written reason deprives a protected right to free and fair competition in the marketplace.

11.7 DrJ is a licensed engineering company, employs licensed RDPs and is an ANAB-Accredited Product Certification Body – Accreditation #1131.

11.8 Through the IAF Multilateral Agreements (MLA), this duly authenticated report can be used to obtain product approval in any jurisdiction or country because all ANAB ISO/IEC 17065 duly authenticated reports are equivalent.<sup>30</sup>

## 12 Conditions of Use

12.1 Material properties shall not fall outside the boundaries defined in **Section 6**.

12.2 As defined in **Section 6**, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.

12.3 As listed herein, Big Timber Screws shall be used:

12.3.1 Only if design properties do not exceed those described in **Section 6**.

12.4 The Big Timber screws in this report shall be designed in accordance with accepted engineering practice for the conditions not covered in this report.

12.5 Moisture content shall be less than or equal to nineteen percent (19%) for sawn lumber and less than sixteen percent (16%) for SCL products.

12.6 Use of fasteners in locations exposed to saltwater or saltwater spray is outside the scope of this report (except for the STX and SCTX screws).

12.7 When required by adopted legislation and enforced by the building official, also known as the authority having jurisdiction (AHJ) in which the project is to be constructed:

12.7.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice and, when prepared by an approved source, shall be approved when signed and sealed.

12.7.2 This report and the installation instructions shall be submitted at the time of permit application.

12.7.3 These innovative products have an internal quality control program and a third-party quality assurance program.

12.7.4 At a minimum, these innovative products shall be installed per **Section 9** of this report.

12.7.5 The review of this report by the AHJ shall comply with IBC Section 104 and IBC Section 105.4.



- 12.7.6 These innovative products have an internal quality control program and a third party quality assurance program in accordance with IBC Section 104.4, IBC Section 110.4, IBC Section 1703, IRC Section R104.4, and IRC Section R109.2.
- 12.7.7 The application of these innovative products in the context of this report is dependent upon the accuracy of the construction documents, implementation of installation instructions, inspection as required by IBC Section 110.3, IRC Section R109.2, and any other regulatory requirements that may apply.
- 12.8 The approval of this report by the AHJ shall comply with IBC Section 1707.1, where legislation states in part, *"the building official shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new material or assemblies as provided for in Section 104.11,"* all of IBC Section 104, and IBC Section 105.4.
- 12.9 Design loads shall be determined in accordance with the regulations adopted by the jurisdiction in which the project is to be constructed and/or by the building designer (i.e., owner or RDP).
- 12.10 The actual design, suitability, and use of this report for any particular building, is the responsibility of the owner or the authorized agent of the owner.

### 13 Identification

- 13.1 The innovative products listed in **Section 1.1** are identified by a label on the board or packaging material bearing the manufacturer name, product name, this report number, and other information to confirm code compliance.
- 13.2 Additional technical information can be found at [www.bigtimberfasteners.com](http://www.bigtimberfasteners.com).

### 14 Review Schedule

- 14.1 This report is subject to periodic review and revision. For the latest version, visit [drjcertification.org](http://drjcertification.org).
- 14.2 For information on the status of this report, please contact [DrJ Certification](#).

### 15 Approved for Use Pursuant to U.S. and International Legislation Defined in Appendix A

- 15.1.1 Big Timber Screws (BL Log, Timber and Landscape Screws, BTX and YTX General Purpose Screws, CTX Construction Lag Screws, GL Gray Structural Screws, STX and SCTX Stainless Screws and WTX Wafer Head Wood Screws) are included in this report published by an approved agency that is concerned with evaluation of products or services, maintains periodic inspection of the production of listed materials or periodic evaluation of services. This report states either that the material, product or service meets recognized standards or has been tested and found suitable for a specified purpose. This report meets the legislative intent and definition of being acceptable to the AHJ.



## Appendix A

### 1 Legislation that Authorizes AHJ Approval

- 1.1 **Fair Competition:** State legislatures have adopted Federal regulations for the examination and approval of building code referenced and alternative products, materials, designs, services, assemblies and/or methods of construction that:
  - 1.1.1 Advance innovation
  - 1.1.2 Promote competition so all businesses have the opportunity to compete on price and quality in an open market on a level playing field unhampered by anticompetitive constraints
  - 1.1.3 Benefit consumers through lower prices, better quality, and greater choice
- 1.2 **Adopted Legislation:** The following local, state and federal regulations affirmatively authorize these innovative products to be approved by AHJs, delegates of building departments and/or delegates of an agency of the federal government:
  - 1.2.1 Interstate commerce is governed by the Federal Department of Justice to encourage the use of innovative products, materials, designs, services, assemblies, and/or methods of construction. The goal is to “*protect economic freedom and opportunity by promoting free and fair competition in the marketplace.*”
  - 1.2.2 Title 18 US Code Section 242 affirms and regulates the right of individuals and businesses to freely and fairly have new products, materials, designs, services, assemblies and/or methods of construction approved for use in commerce. Disapproval of alternatives shall be based upon non-conformance with respect to specific provisions of adopted legislation and shall be provided in writing stating the reasons why the alternative was not approved, with reference to the specific legislation violated.
  - 1.2.3 The federal government and each state have a public records act. In addition, each state also has legislation that mimics the federal Defend Trade Secrets Act 2016 (DTSA),<sup>31</sup> where providing test reports, engineering analysis and/or other related IP/TS is subject to prison of not more than ten years<sup>32</sup> and/or a \$5,000,000 fine or 3 times the value of<sup>33</sup> the Intellectual Property (IP) and Trade Secrets (TS).
    - 1.2.3.1 Compliance with public records and trade secret legislation requires approval through the use of Listings, certified reports, Technical Evaluation Reports, duly authenticated reports and/or research reports prepared by approved agencies and/or approved sources.
  - 1.2.4 For new materials<sup>34</sup> that are not specifically provided for in any regulation, the design strengths and permissible stresses shall be established by tests, where suitable load tests simulate the actual loads and conditions of application that occur.
  - 1.2.5 The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design using accepted engineering practice.<sup>35</sup>
  - 1.2.6 The commerce of approved sources (i.e., registered PEs) is regulated by professional engineering legislation. Professional engineering commerce shall always be approved by AHJs, except where there is evidence provided in writing, that specific legislation have been violated by an individual registered PE.
  - 1.2.7 The AHJ shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in IBC Section 104.11.<sup>36</sup>



- 1.3 **Approved<sup>37</sup> by Los Angeles:** The Los Angeles Municipal Code (LAMC) states in pertinent part that the provisions of LAMC are not intended to prevent the use of any material, device or method of construction not specifically prescribed by LAMC. The Department shall use Part III, Recognized Standards in addition to Part II, Uniform Building Code Standards of Division 35, Article 1, Chapter IX of the LAMC in evaluation of products for approval where such standard exists for the product or the material and may use other approved standards that apply. Whenever tests or certificates of any material or fabricated assembly are required by Chapter IX of the LAMC, such tests or certification shall be made by a testing agency approved by the Superintendent of Building to conduct such tests or provide such certifications. The testing agency shall publish the scope and limitation(s) of the listed material or fabricated assembly.<sup>38</sup> The Superintendent of Building Approved Testing Agency Roster is provided by the Los Angeles Department of Building and Safety (LADBS). The Center for Building Innovation (CBI) Certificate of Approval License is TA24945. Tests and certifications found in a DrJ Listing are LAMC approved. In addition, the Superintendent of Building shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in the California Building Code (CBC) Section 1707.1.<sup>39</sup>
- 1.4 **Approved by Chicago:** The Municipal Code of Chicago (MCC) states in pertinent part that an Approved Agency is a Nationally Recognized Testing Laboratory (NRTL) acting within its recognized scope and/or a certification body accredited by the American National Standards Institute (ANSI) acting within its accredited scope. Construction materials and test procedures shall conform to the applicable standards listed in the MCC. Sufficient technical data shall be submitted to the building official to substantiate the proposed use of any product, material, service, design, assembly and/or method of construction not specifically provided for in the MCC. This technical data shall consist of research reports from approved sources (i.e., MCC defined Approved Agencies).
- 1.5 **Approved by New York City:** The 2022 NYC Building Code (NYCBC) states in part that an approved agency shall be deemed<sup>40</sup> an approved testing agency via ISO/IEC 17025 accreditation, an approved inspection agency via ISO/IEC 17020 accreditation, and an approved product evaluation agency via ISO/IEC 17065 accreditation. Accrediting agencies, other than federal agencies, must be members of an internationally recognized cooperation of laboratory and inspection accreditation bodies subject to a mutual recognition agreement<sup>41</sup> (i.e., ANAB, International Accreditation Forum also known as IAF, etc.).
- 1.6 **Approved by Florida:** Statewide approval of products, methods or systems of construction shall be approved, without further evaluation by:
- 1.6.1 A certification mark or listing of an approved certification agency,
  - 1.6.2 A test report from an approved testing laboratory,
  - 1.6.3 A product evaluation report based upon testing or comparative or rational analysis, or a combination thereof, from an approved product evaluation entity, or
  - 1.6.4 A product evaluation report based upon testing, comparative or rational analysis, or a combination thereof, developed, signed and sealed by a professional engineer or architect, licensed in Florida.
  - 1.6.5 For local product approval, products or systems of construction shall demonstrate compliance with the structural wind load requirements of the Florida Building Code (FBC) through one of the following methods:
    - 1.6.5.1 A certification mark, listing or label from a commission-approved certification agency indicating that the product complies with the code,
    - 1.6.5.2 A test report from a commission-approved testing laboratory indicating that the product tested complies with the code,
    - 1.6.5.3 A product-evaluation report based upon testing, comparative or rational analysis, or a combination thereof, from a commission-approved product evaluation entity which indicates that the product evaluated complies with the code,



- 1.6.5.4 A product-evaluation report or certification based upon testing or comparative or rational analysis, or a combination thereof, developed and signed and sealed by a Florida professional engineer or Florida registered architect, which indicates that the product complies with the code, or
- 1.6.5.5 A statewide product approval issued by the Florida Building Commission.
- 1.6.6 The [Florida Department of Business and Professional Regulation \(DBPR\)](#) website provides a listing of companies certified as a [Product Evaluation Agency](#) (i.e., EVLMiami 13692), a [Product Certification Agency](#) (i.e., CER10642), and as a [Florida Registered Engineer](#) (i.e., ANE13741).
- 1.7 **Approved by Miami-Dade County (i.e., Notice of Acceptance [NOA]):** A Florida statewide approval is an NOA. An NOA is a Florida local product approval. By Florida law, Miami-Dade County shall accept the statewide and local Florida Product Approval as provided for in Florida legislation [553.842](#) and [553.8425](#).
- 1.8 **Approved by New Jersey:** Pursuant to the 2018 Building Code of New Jersey in [IBC Section 1707.1 General](#),<sup>42</sup> it states: “*In the absence of approved rules or other approved standards, the building official shall accept duly authenticated reports from [approved agencies](#) in respect to the quality and manner of use of new materials or assemblies as provided for in the administrative provisions of the Uniform Construction Code (N.J.A.C. 5:23)*”.<sup>43</sup> Furthermore N.J.A.C 5:23-3.7 states: “*Municipal approvals of alternative materials, equipment, or methods of construction.*”
  - 1.8.1 **Approvals:** Alternative materials, equipment or methods of construction shall be approved by the appropriate subcode official provided the proposed design is satisfactory and that the materials, equipment or methods of construction are suitable for the intended use and are at least the equivalent in quality, strength, effectiveness, fire resistance, durability and safety of those conforming with the requirements of the regulations.
    - 1.8.1.1 A field evaluation label and report or letter issued by a nationally recognized testing laboratory verifying that the specific material, equipment or method of construction meets the identified standards or has been tested and found to be suitable for the intended use, shall be accepted by the appropriate subcode official as meeting the requirements of the above.
    - 1.8.1.2 Reports of engineering findings issued by nationally recognized evaluation service programs such as but not limited to, the Building Officials and Code Administrators (BOCA), the International Conference of Building Officials (ICBO), the Southern Building Code Congress International (SBCCI), the International Code Council (ICC), and the National Evaluation Service, Inc., shall be accepted by the appropriate subcode official as meeting the requirements of the above.
  - 1.8.2 The [New Jersey Department of Community Affairs](#) has confirmed that technical evaluation reports, from any accredited entity listed by [ANAB](#), meets the requirements of item the previous paragraph, given that the listed entities are no longer in existence and/or do not provide “*reports of engineering findings.*”
- 1.9 **Approved by the Code of Federal Regulations Manufactured Home Construction and Safety Standards:** Pursuant to Title 24, Subtitle B, Chapter XX, [Part 3282.14](#)<sup>44</sup> and [Part 3280](#),<sup>45</sup> the Department encourages innovation and the use of new technology in manufactured homes. The design and construction of a manufactured home shall conform to the provisions of Part 3282 and Part 3280 where key approval provisions in mandatory language follow:
  - 1.9.1 “*All construction methods shall be in conformance with accepted engineering practices.*”
  - 1.9.2 “*The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.*”
  - 1.9.3 “*The design stresses of all materials shall conform to accepted engineering practice.*”



- 1.10 **Approval by US, Local and State Jurisdictions in General:** In all other local and state jurisdictions, the adopted building code legislation states in pertinent part that:
- 1.10.1 For new materials that are not specifically provided for in this code, the design strengths and permissible stresses shall be established by tests.<sup>46</sup>
  - 1.10.2 For innovative alternatives and/or methods of construction, the building official shall accept duly authenticated reports from approved agencies with respect to the quality and manner of use of new materials or assemblies.<sup>47</sup>
    - 1.10.2.1 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is in the ANAB directory.
    - 1.10.2.2 An approved source is “approved” when an RDP is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.<sup>48</sup>
  - 1.10.3 The design strengths and permissible stresses of any structural material...shall conform to the specifications and methods of design of accepted engineering practice performed by an approved source.<sup>49</sup>
- 1.11 **Approval by International Jurisdictions:** The USMCA and GATT agreements provide for approval of innovative materials, designs, services, and/or methods of construction through the Agreement on Technical Barriers to Trade and the IAF Multilateral Recognition Arrangement (MLA), where these agreements:
- 1.11.1 State that conformity assessment procedures (i.e., ISO/IEC 17020, 17025, 17065, etc.) are prepared, adopted, and applied so as to grant access for suppliers of like products originating in the territories of other Members under conditions no less favourable than those accorded to suppliers of like products of national origin or originating in any other country, in a comparable situation.
  - 1.11.2 **Approved:** The purpose of the MLA is to ensure mutual recognition of accredited certification and validation/verification statements between signatories to the MLA and subsequently, acceptance of accredited certification and validation/verification statements in many markets based on one accreditation for the timely approval of innovative materials, designs, services, and/or methods of construction.
  - 1.11.3 ANAB is an IAF-MLA signatory where recognition of certificates, validation, and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA, with the appropriate scope, shall be approved.<sup>50</sup>
  - 1.11.4 Therefore, all ANAB ISO/IEC 17065 duly authenticated reports are approval equivalent.<sup>51</sup>
- 1.12 Approval equity is a fundamental commercial and legal principle.<sup>52</sup>



- For more information, visit [drjc certification.org](http://drjc certification.org) or call us at 608-310-6748.
- 2018 IBC Section 2304.10.5
- <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1702>
- Alternative Materials, Design and Methods of Construction and Equipment: The provisions of any regulation code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by a regulation. Please review <https://www.justice.gov/atr/mission> and <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104.11>
- <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706> ~:~text=the%20design%20strengths%20and%20permissible%20stresses%20shall%20be%20established%20by%20tests%20as
- The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design of accepted engineering practice.
- <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706> ~:~text=shall%20conform%20to%20the%20specifications%20and%20methods%20of%20design%20of%20accepted%20engineering%20practice
- <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707.1> ~:~text=the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies
- <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1703.4.2>
- [https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved\\_agency](https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved_agency)
- [https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved\\_source](https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved_source)
- <https://www.law.cornell.edu/uscode/text/18/1832> (b) Any organization that commits any offense described in subsection (a) shall be fined not more than the greater of \$5,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided. The federal government and each state have a [public records act](#). To follow DTSA and comply state public records and trade secret legislation requires approval through ANAB ISO/IEC 17065 accredited certification bodies or [approved sources](#). For more information, please review this website: [Intellectual Property and Trade Secrets](#).
- <https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>
- <https://www.cbiteest.com/accreditation/>
- <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104> ~:~text=to%20enforce%20the%20provisions%20of%20this%20code
- <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104.11> ~:~text=Where%20the%20alternative%20material%2C%20design%20or%20method%20of%20construction%20is%20not%20approved%2C%20the%20building%20official%20shall%20respond%20in%20writing%2C%20stating%20the%20reasons%20why%20the%20alternative%20was%20not%20approved AND
- <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#105.3.1> ~:~text=If%20the%20application%20or%20the%20construction%20documents%20do%20not%20conform%20to%20the%20requirements%20of%20pertinent%20laws%2C%20the%20building%20official%20shall%20reject%20such%20application%20in%20writing%2C%20stating%20the%20reasons%20therefore
- <https://up.codes/viewer/colorado/ibc-2021/chapter/17/special-inspections-and-tests#1707.1> ~:~text=the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies%20in%20respect%20to%20the%20quality%20and%20manner%20of%20use%20of%20new%20materials%20or%20assemblies%20as%20provided%20for%20in%20Section%20104.11
- <https://iaf.nu/en/about-iaf-mla/#> ~:~text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope
- True for all ANAB accredited product evaluation agencies and all International Trade Agreements.
- <https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>
- Unless otherwise noted, all references in this Listing are from the 2021 version of the codes and the standards referenced therein. This material, product, design, service and/or method of construction also complies with the 2000-2021 versions of the referenced codes and the standards referenced therein.
- <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#p-3280.2> (Listed%20or%20certified); <https://up.codes/viewer/colorado/ibc-2021/chapter/2/definitions#listed> AND <https://up.codes/viewer/colorado/ibc-2021/chapter/2/definitions#labeled>
- <https://up.codes/viewer/colorado/ibc-2021/chapter/17/special-inspections-and-tests#1703.4>
- <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#> ~:~text=All%20construction%20methods%20shall%20be%20in%20conformance%20with%20accepted%20engineering%20practices%20to%20insure%20durable%2C%20livable%2C%20and%20safe%20housing%20and%20shall%20demonstrate%20acceptable%20workmanship%20reflecting%20journeyman%20quality%20of%20work%20of%20the%20various%20trades
- <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#> ~:~text=The%20strength%20and%20rigidity%20of%20the%20component%20parts%20and/or%20the%20integrated%20structure%20shall%20be%20determined%20by%20engineering%20analysis%20or%20by%20suitable%20load%20tests%20to%20simulate%20the%20actual%20loads%20and%20conditions%20of%20application%20that%20occur
- Qualification is performed by a legislatively defined [Accreditation Body](#). ANSI National Accreditation Board (ANAB) is the largest independent accreditation body in North America and provides services in more than 75 countries. [Dr.J](#) is an ANAB accredited [product certification body](#).
- See Code of Federal Regulations (CFR) [Title 24 Subtitle B Chapter XX Part 3280](#) for definition.
- 2018 IFC Section 104.9
- Approved is an adjective that modifies the noun after it. For example, Approved Agency means that the Agency is accepted officially as being suitable in a particular situation. This example conforms to IBC/IRC/IFC [Section 201.4](#) where the building code authorizes sentences to have an ordinarily accepted meaning such as the context implies.
- <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>



Multilateral approval is true for all ANAB accredited product evaluation agencies and all International Trade Agreements.

<http://www.drjengineering.org/AppendixC> AND <https://www.drjcertification.org/comell-2016-protection-trade-secrets>

<https://www.law.cornell.edu/uscode/text/18/1832#:~:text=imprisoned%20not%20more%20than%2010%20years>

<https://www.law.cornell.edu/uscode/text/18/1832#:~:text=Any%20organization%20that,has%20thereby%20avoided>

<https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706.2>

IBC 2021, Section 1706.1 Conformance to Standards

IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General

See **Section 11** for the distilled building code definition of **Approved**.

Los Angeles Municipal Code, SEC. 98.0503. TESTING AGENCIES

<https://up.codes/viewer/california/ca-building-code-2022/chapter/17/special-inspections-and-tests#1707.1>

New York City, The Rules of the City of New York, § 101-07 Approved Agencies

New York City, The Rules of the City of New York, § 101-07 Approved Agencies

<https://up.codes/viewer/new-jersey/ibc-2018/chapter/17/special-inspections-and-tests#1707.1>

<https://www.nj.gov/dca/divisions/codes/codreg/ucc.html>

<https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3282/subpart-A/section-3282.14>

<https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>

IBC 2021, Section 1706 Design Strengths of Materials, 1706.2 New Materials. Adopted law pursuant to IBC model code language 1706.2.

IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General. Adopted law pursuant to IBC model code language 1707.1.

<https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>

IBC 2021, Section 1706 Design Strengths of Materials, Section 1706.1 Conformance to Standards Adopted law pursuant to IBC model code language 1706.1.

[https://iaf.nu/en/about-iaf-](https://iaf.nu/en/about-iaf-mla/#:~:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope)

[mla/#:~:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope](https://iaf.nu/en/about-iaf-mla/#:~:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope)

True for all ANAB accredited product evaluation agencies and all International Trade Agreements.

<https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>